
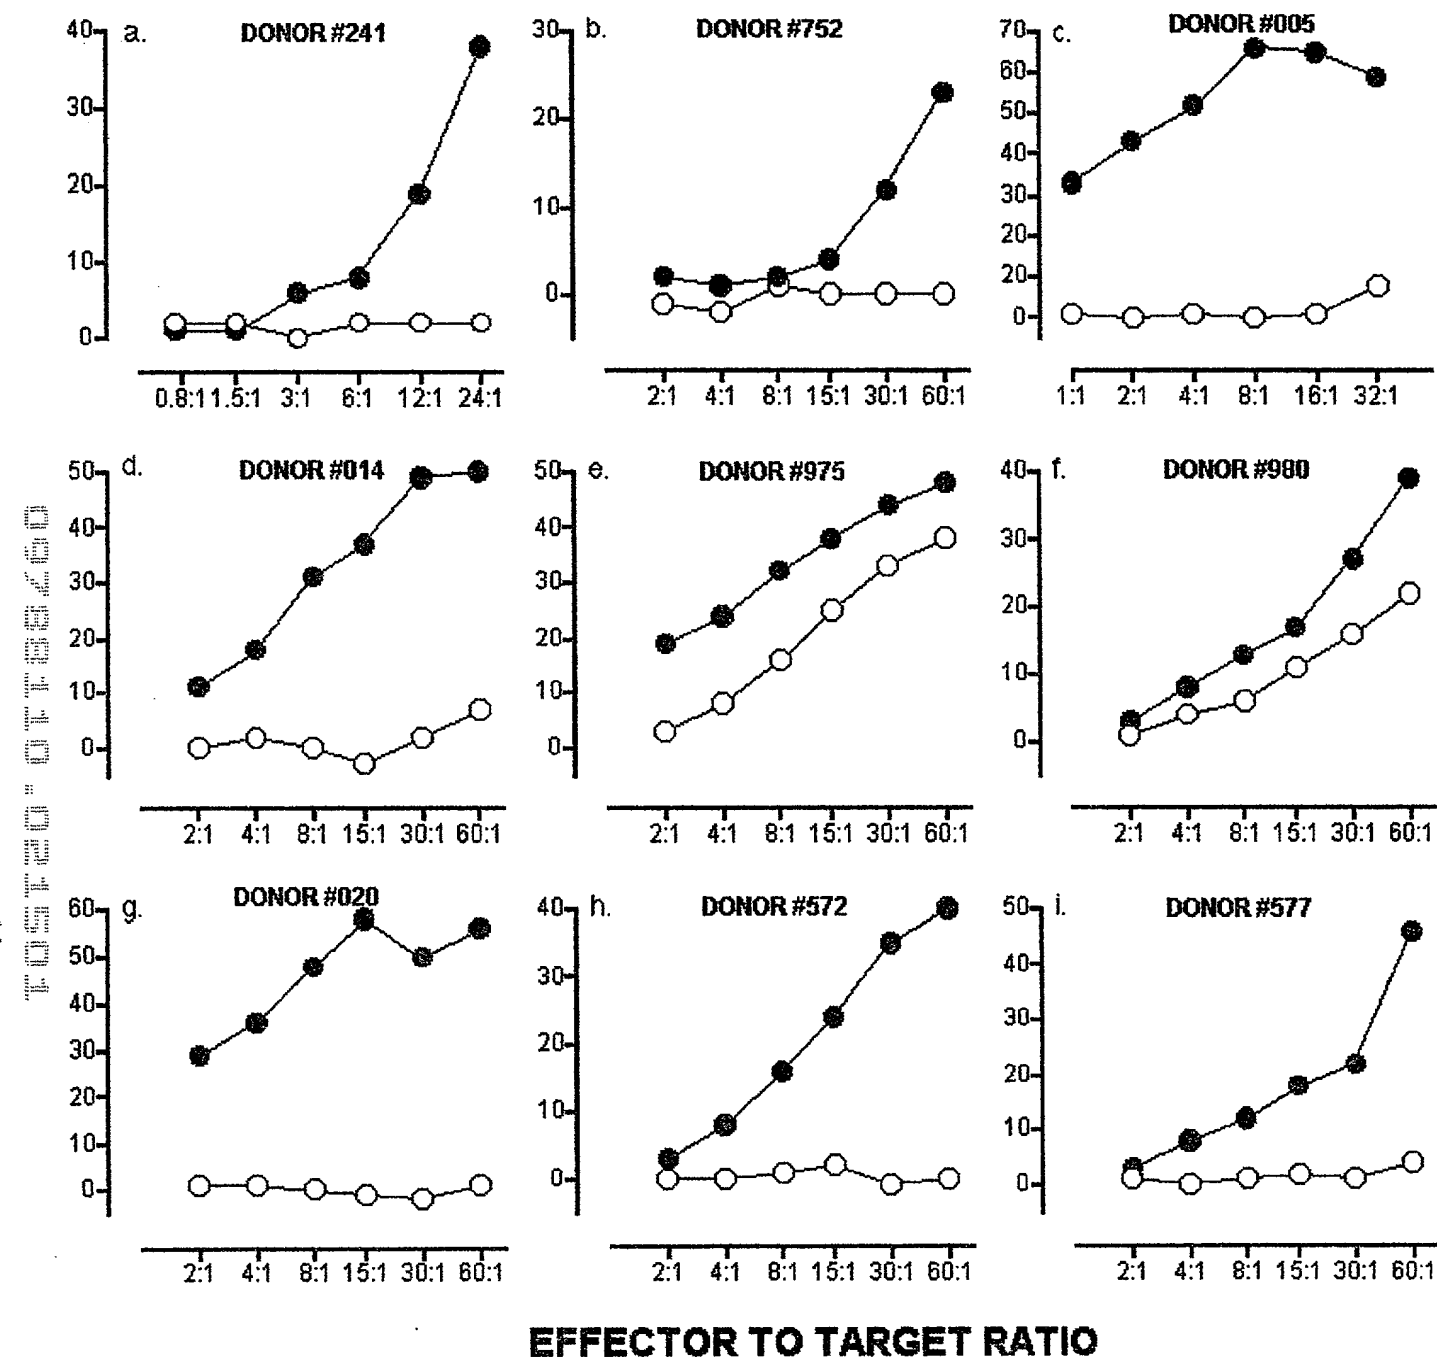


**A.**


**% SPECIFIC  $^{51}\text{Cr}$  RELEASE**

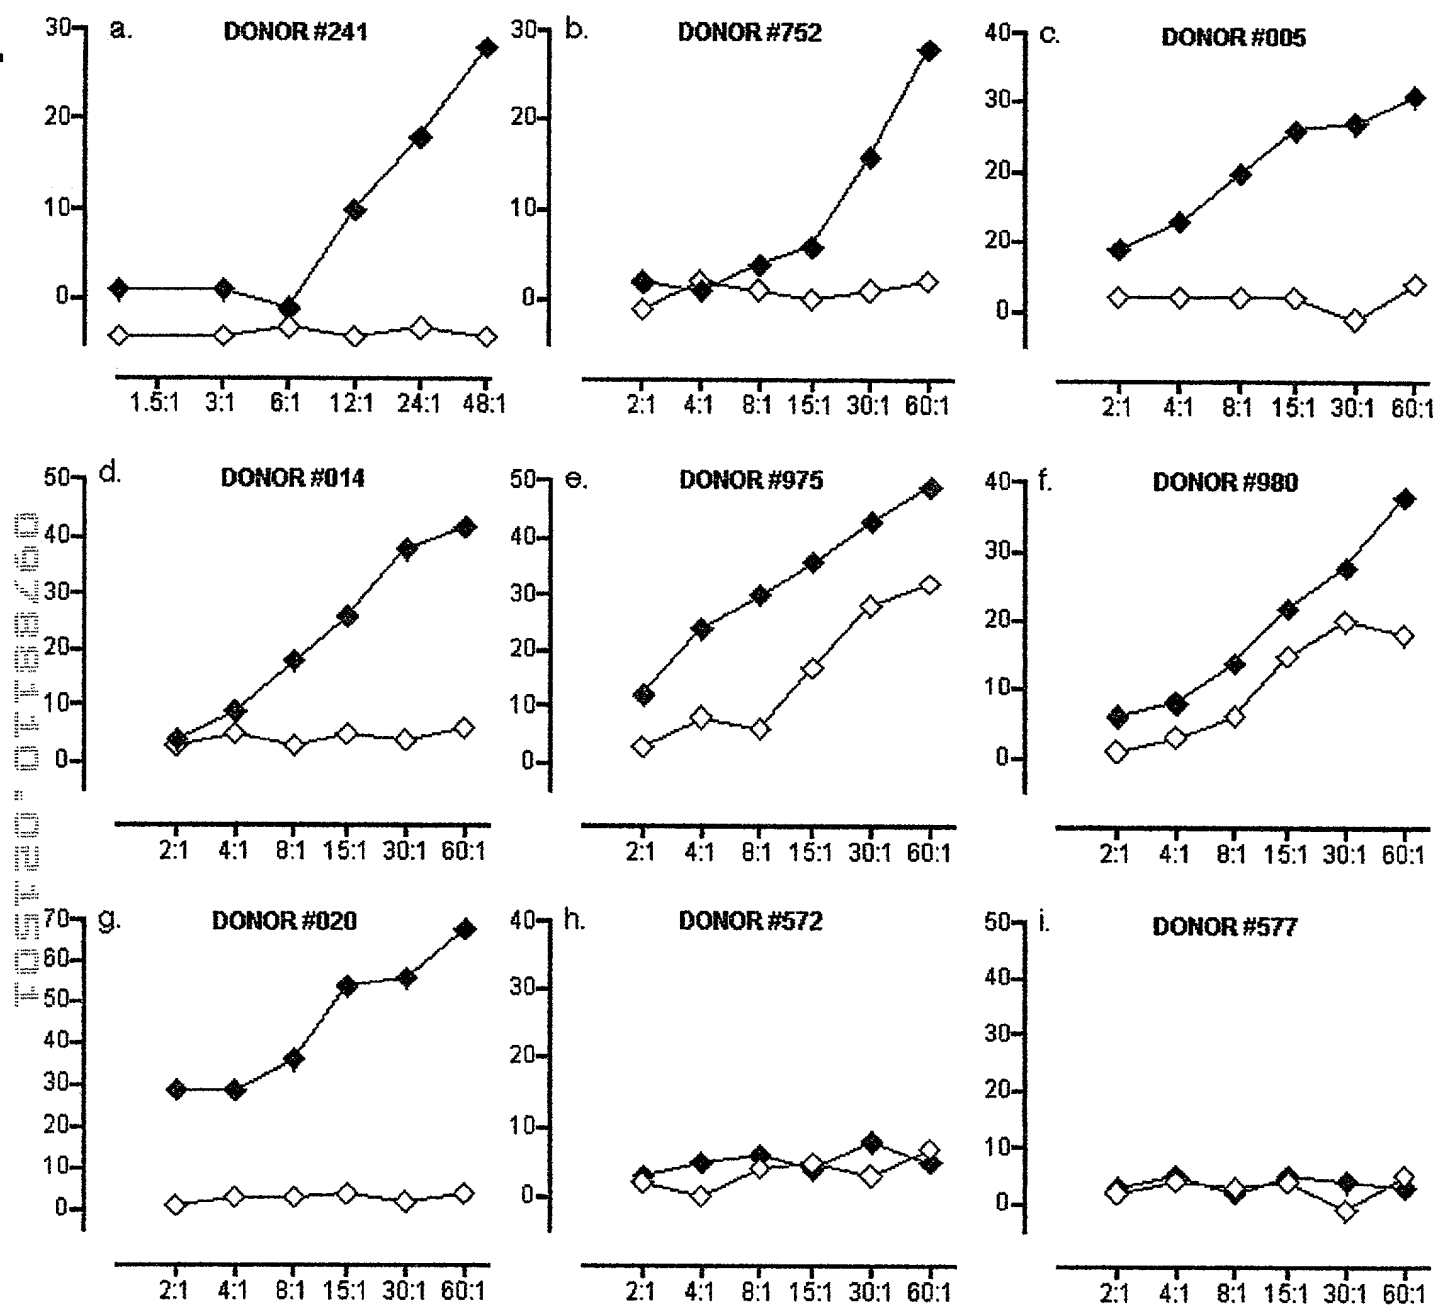


**Figure 1 A**

**B.****% SPECIFIC  $^{51}\text{Cr}$  RELEASE****EFFECTOR TO TARGET RATIO****Figure 1 B**

**A.**

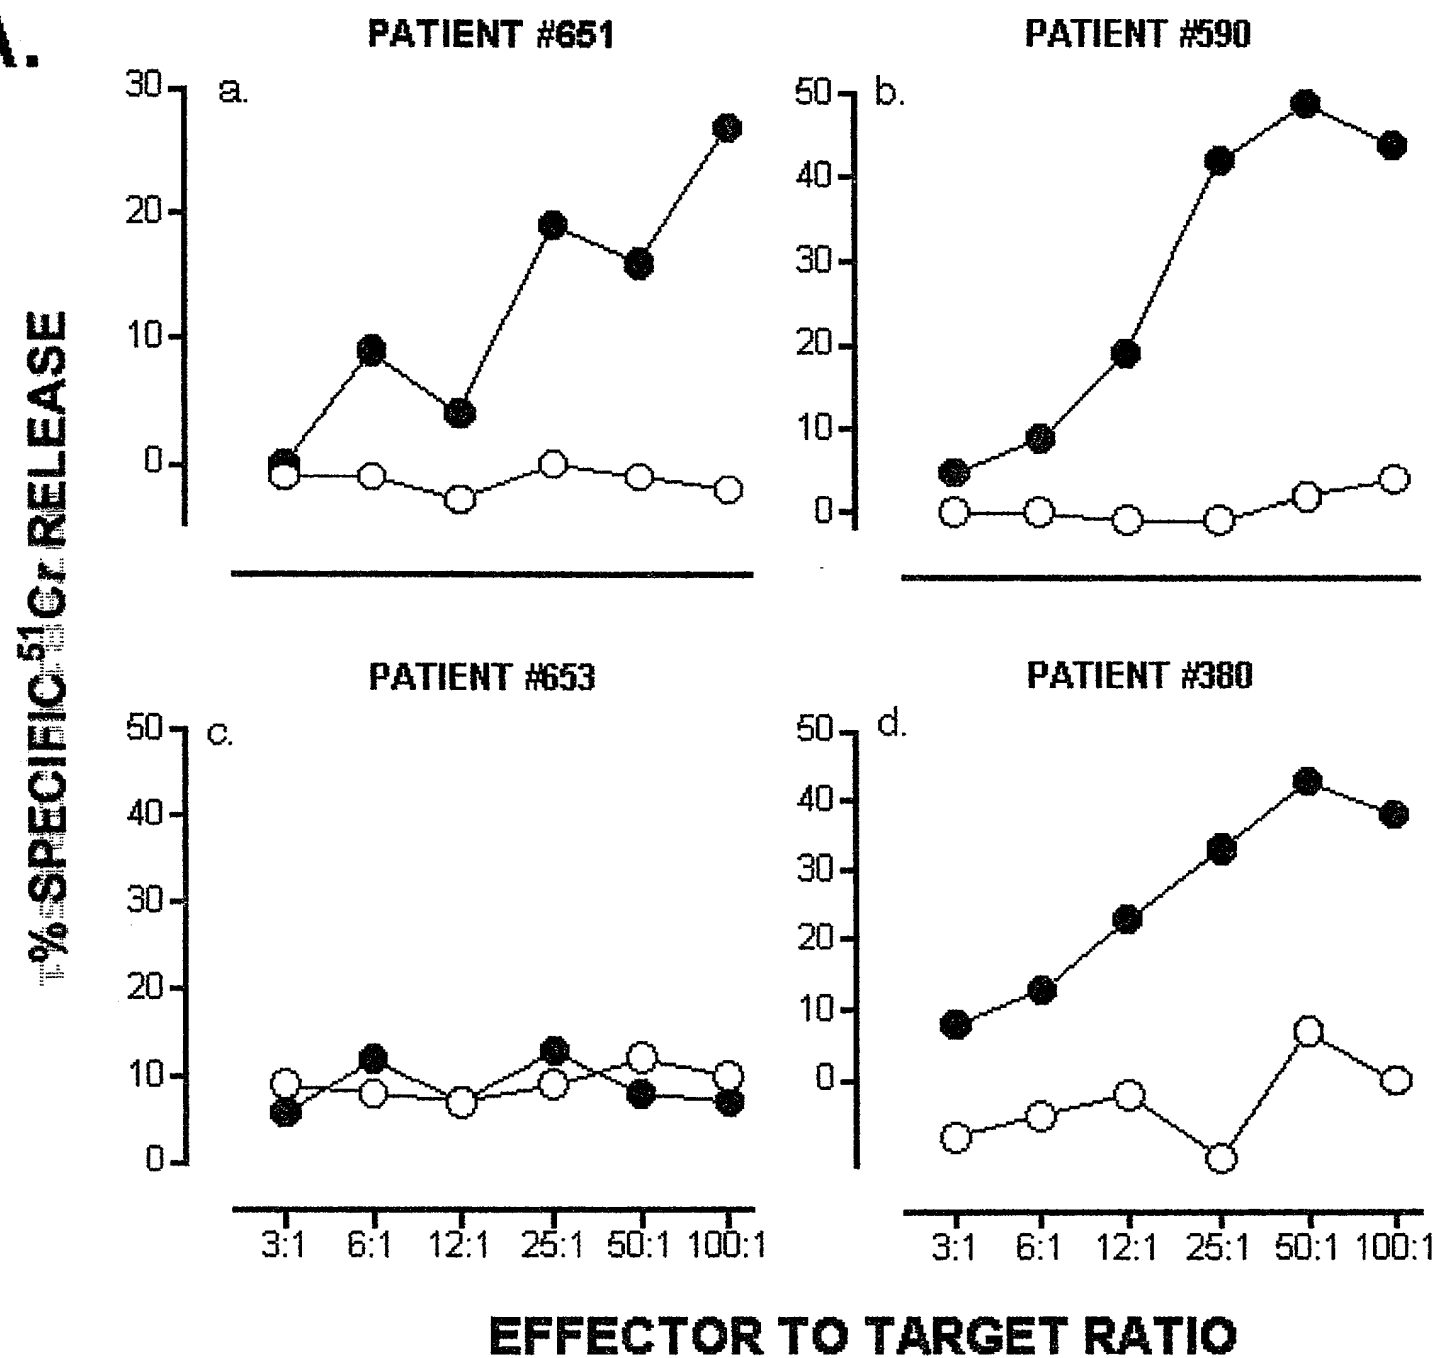

**Figure 2 A**

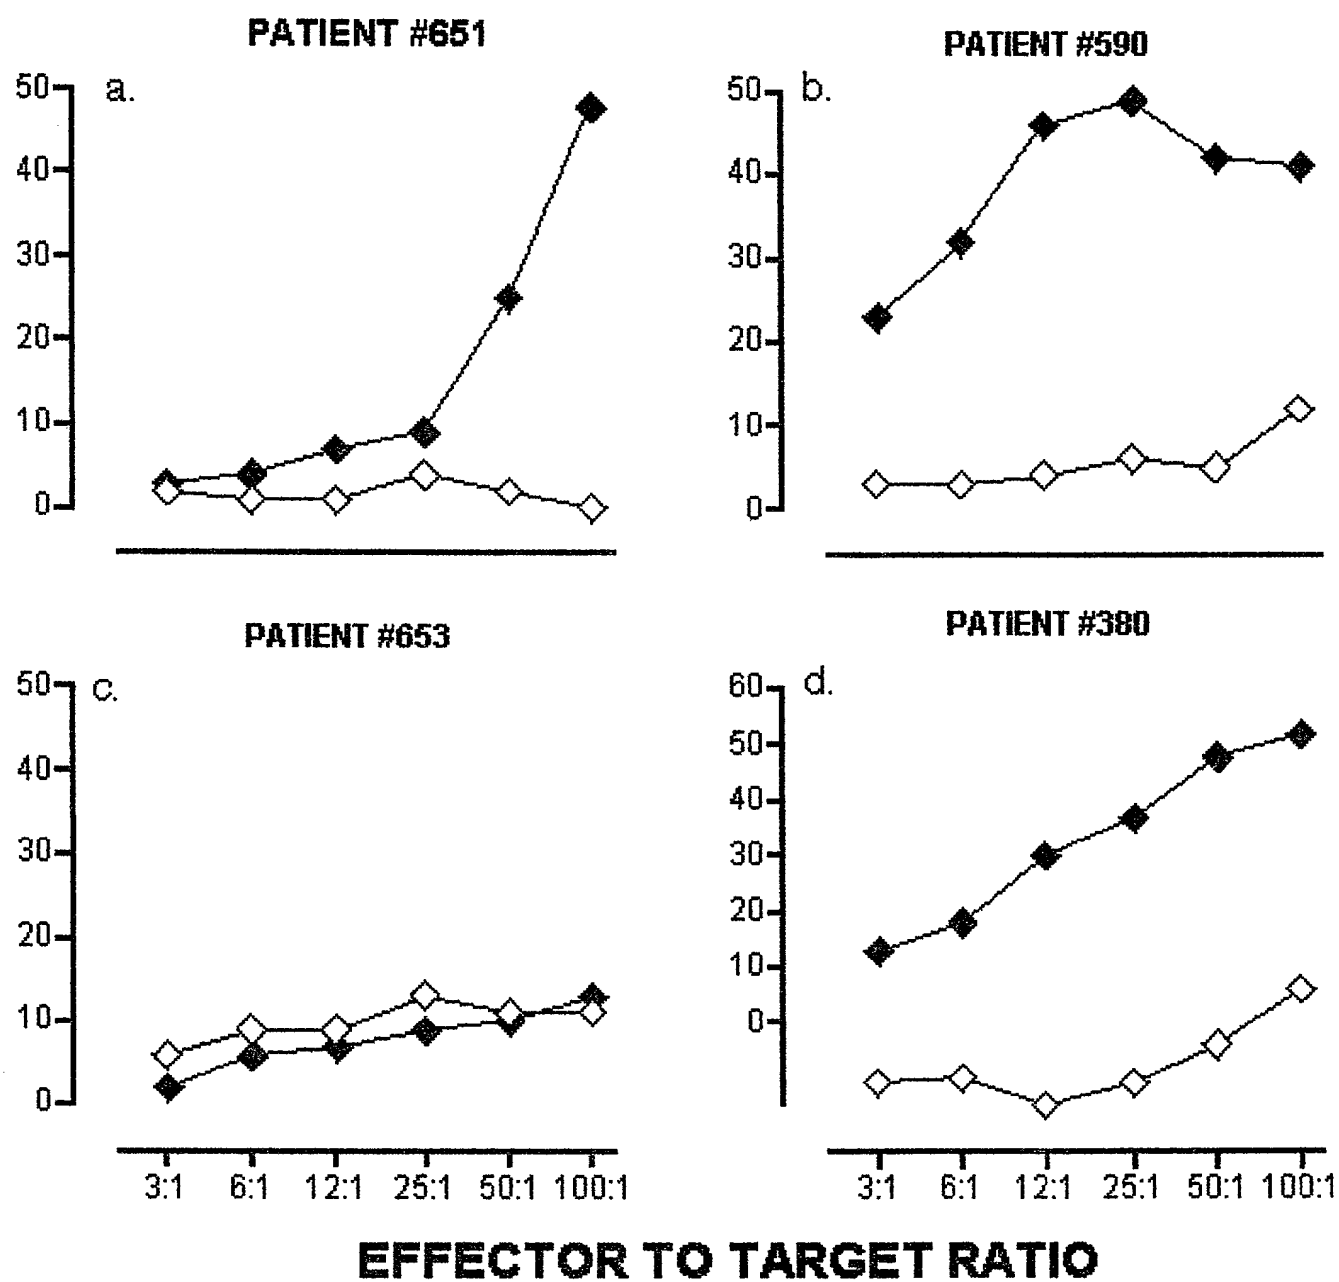**B.****% SPECIFIC <sup>51</sup>Cr RELEASE****Figure 2 B**



**C.**

**% SPECIFIC  $^{51}\text{Cr}$  RELEASE**

TESTED: 07/88/60



**PATIENT #651**

**PATIENT #590**

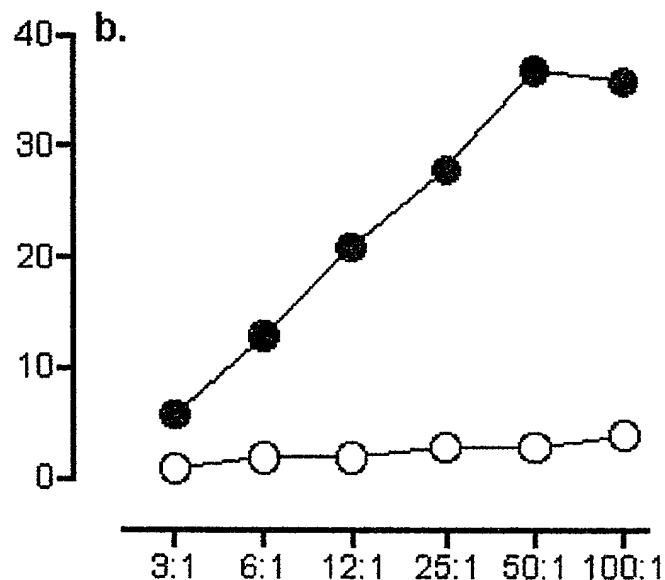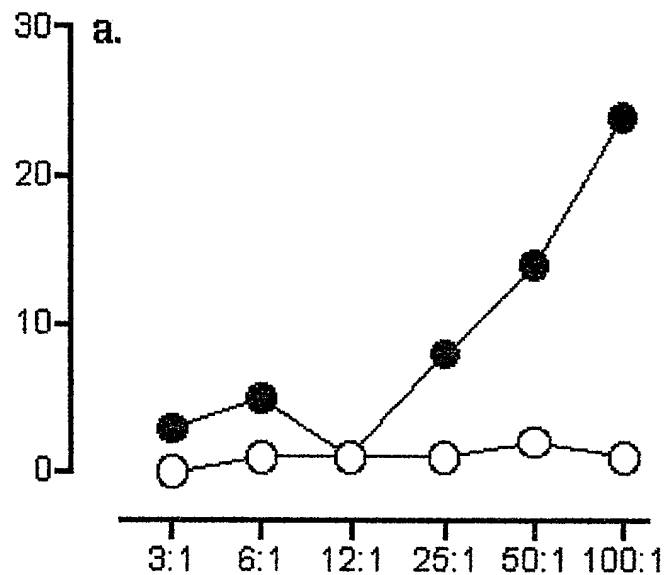

**PATIENT #651**

**PATIENT #590**

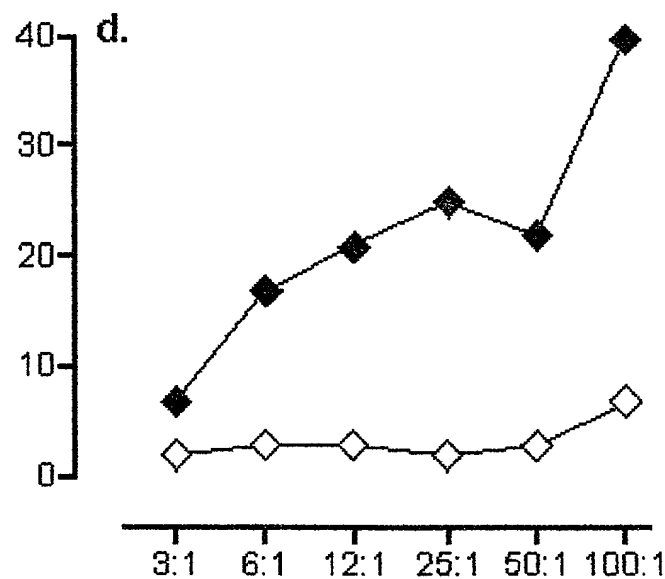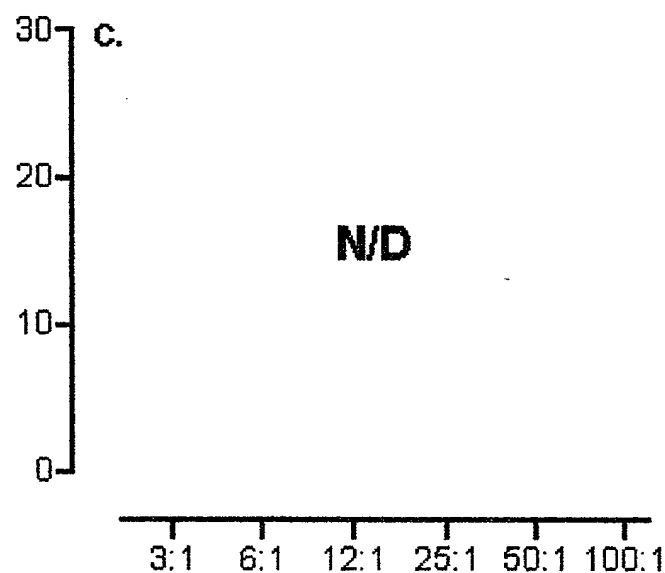

**EFFECTOR TO TARGET RATIO**

**Figure 2 C**

0978310.051  
T05120-0188260


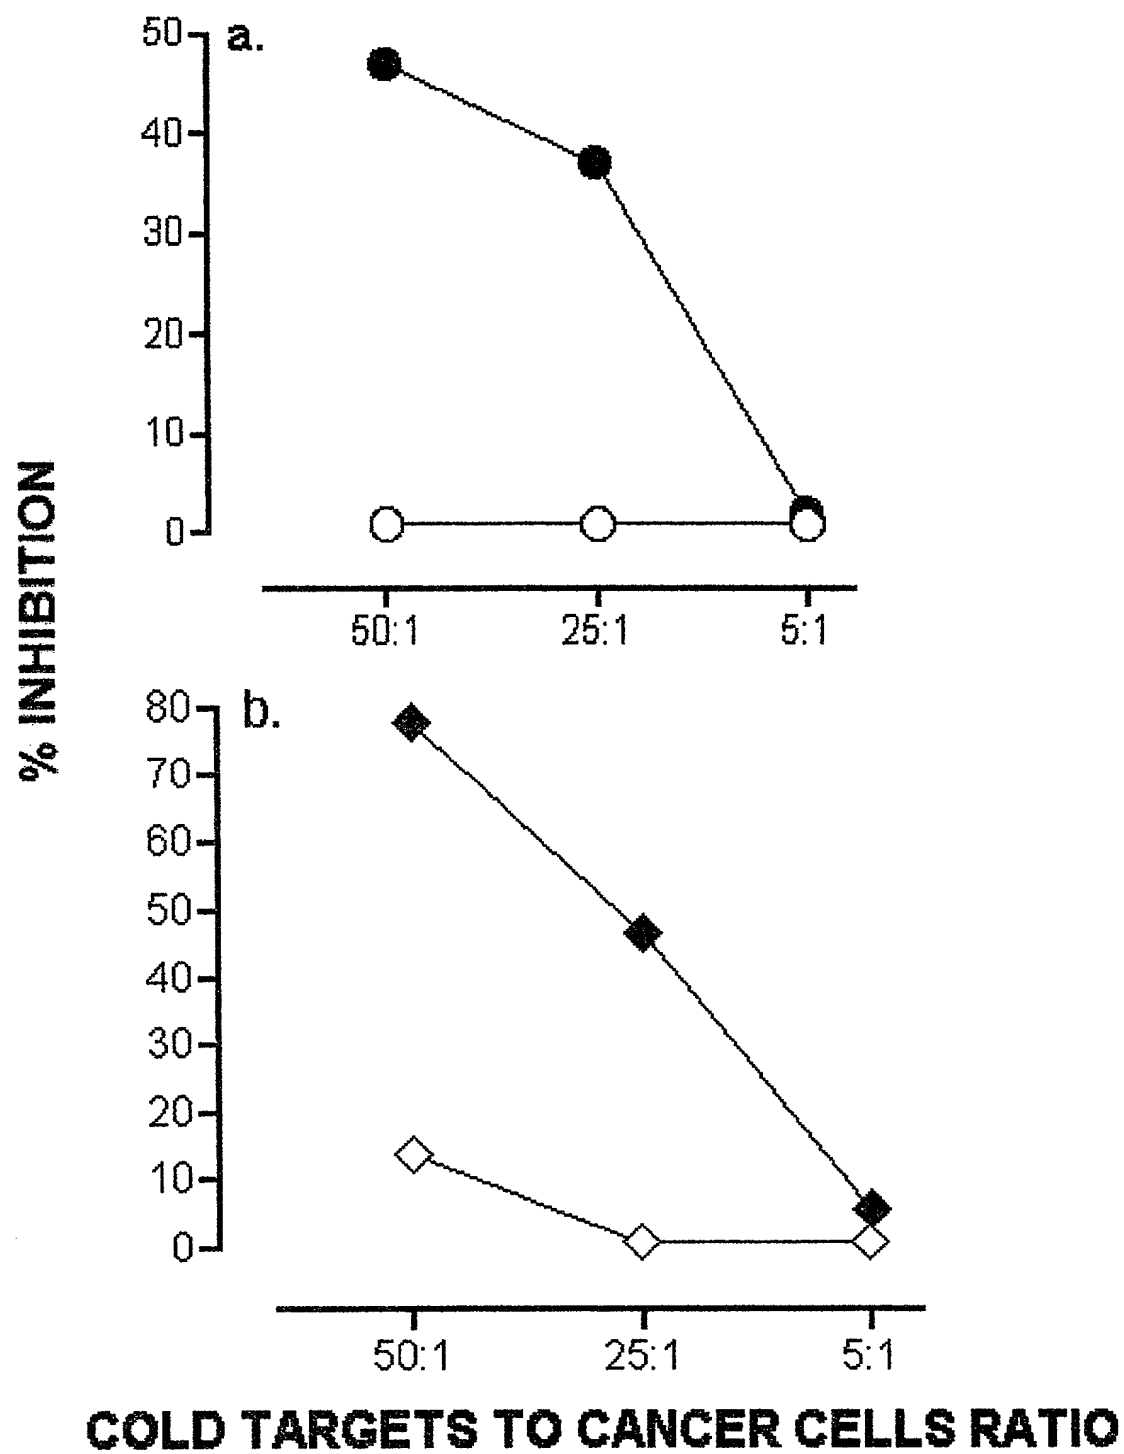



Figure 3 A

**B.**

**% SPECIFIC  $^{51}\text{Cr}$  RELEASE**

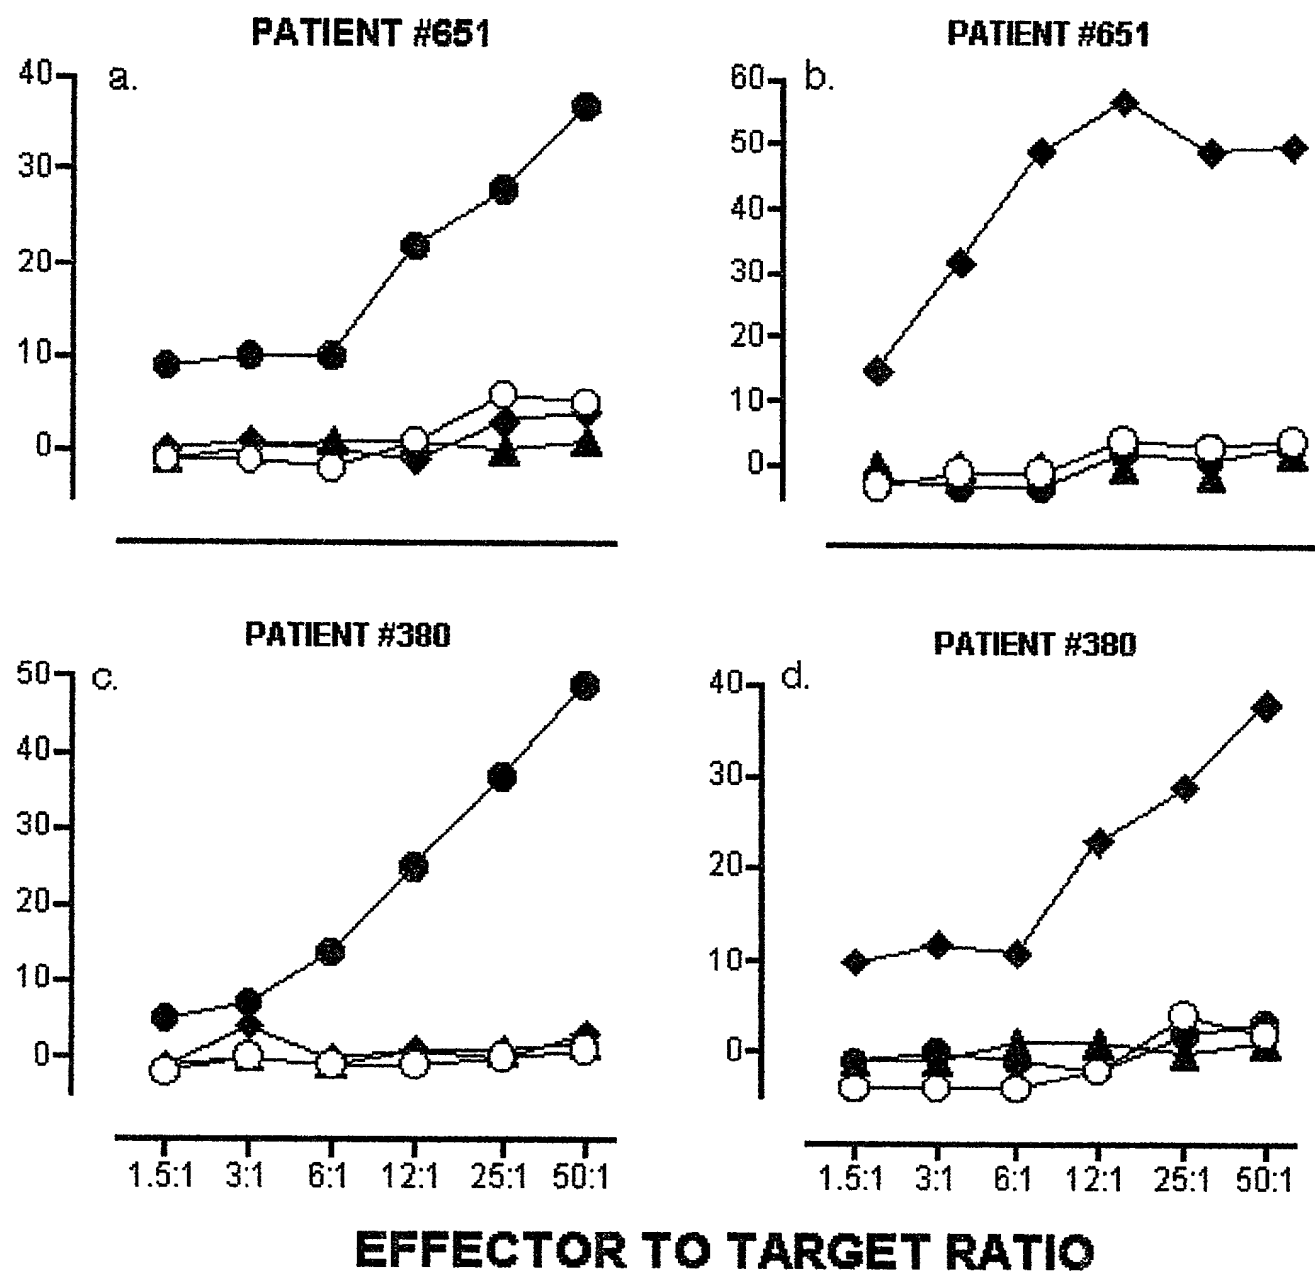


**Figure 3 B**

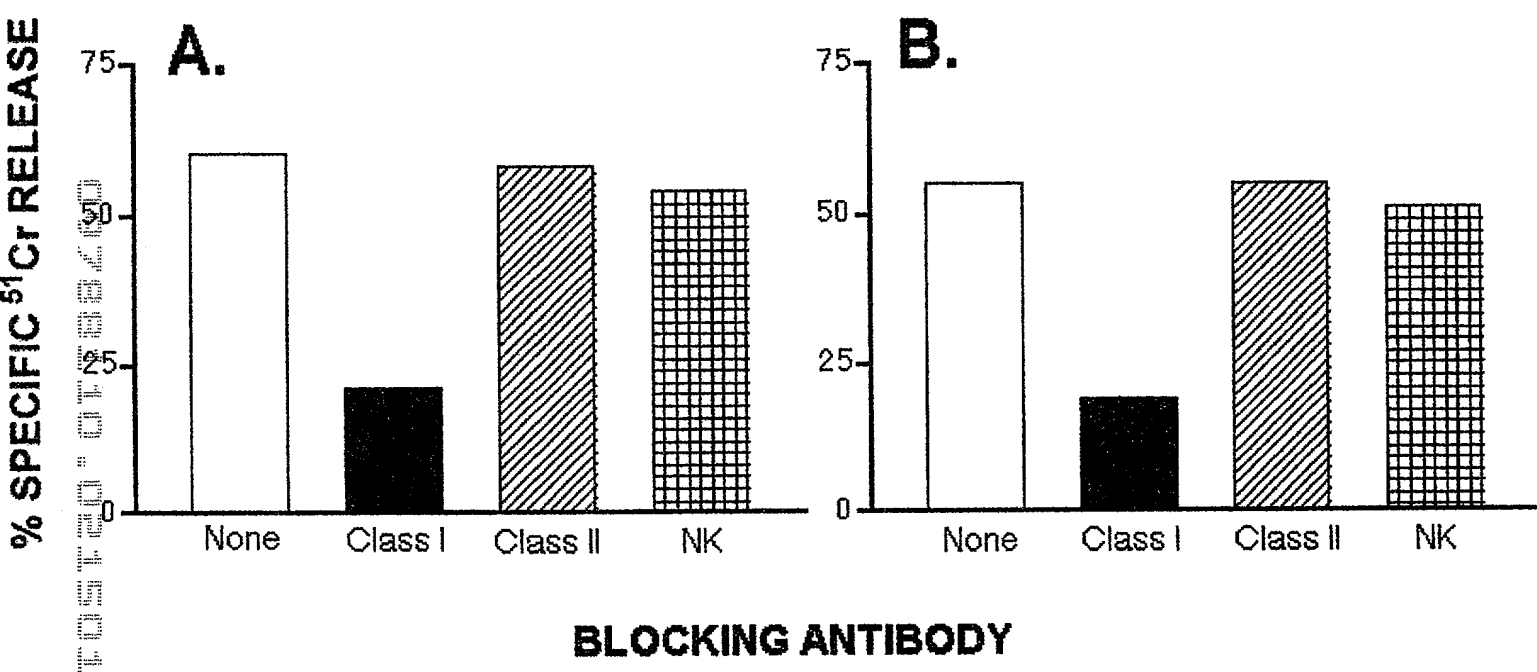


**Figure 4**



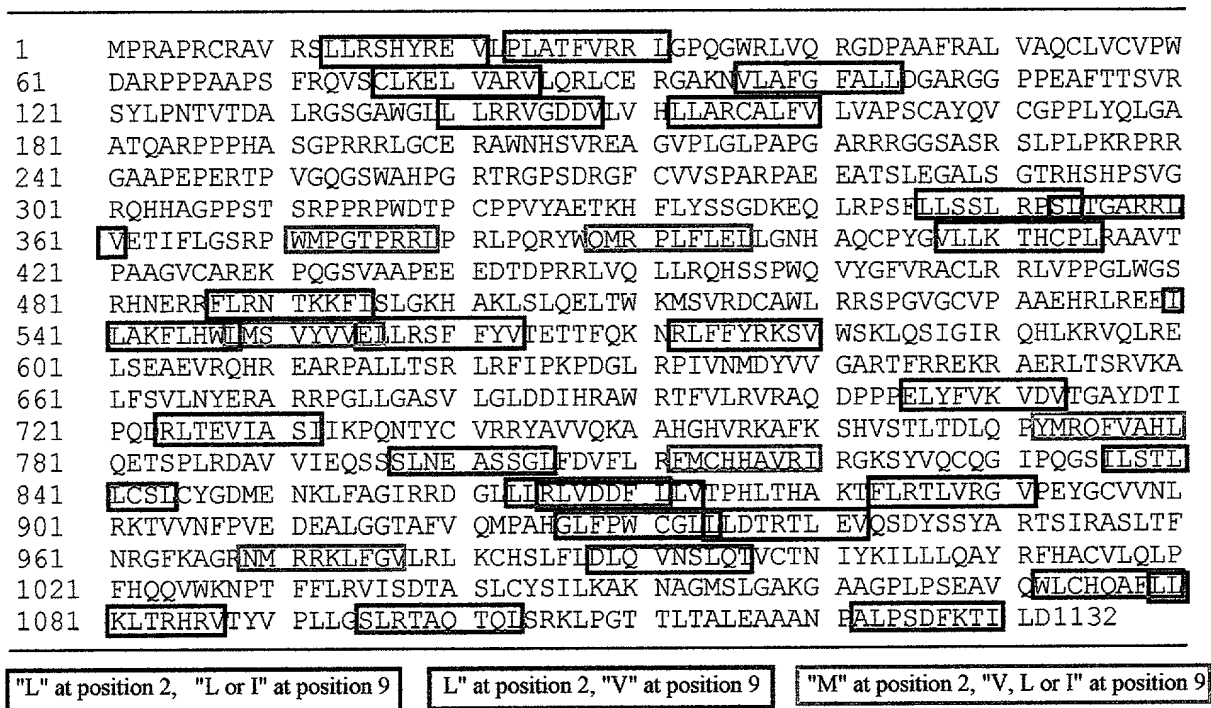

**Figure 5**

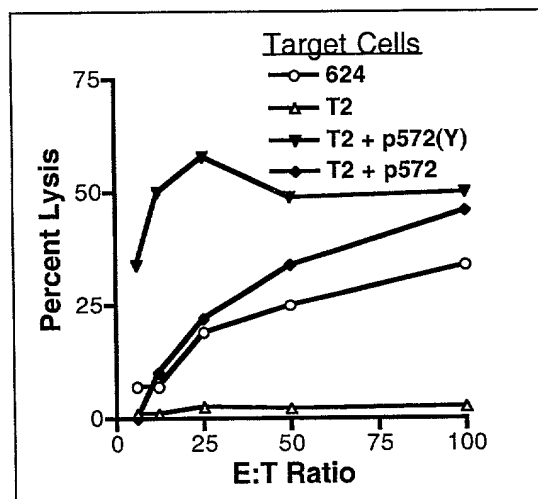

**Figure 6**

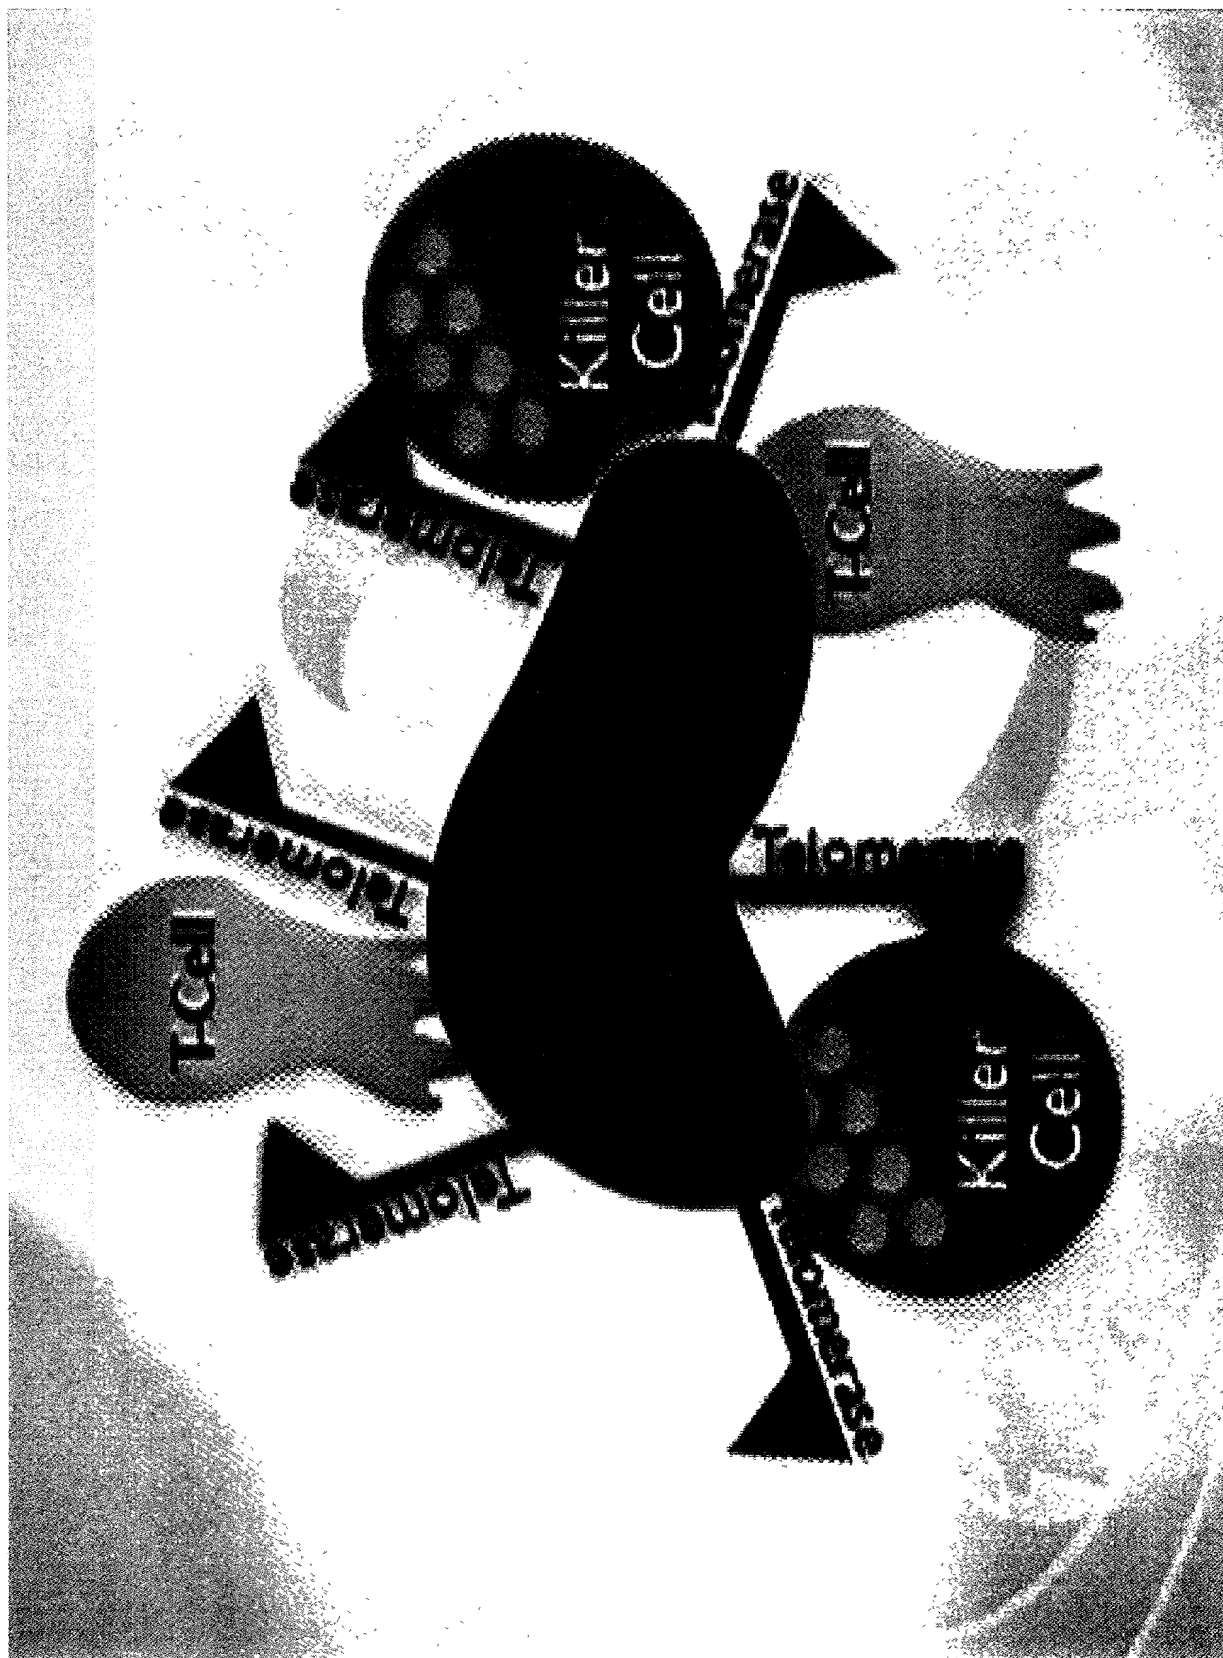


Figure 7